

Symphon·Ξ

Configuration Manual — Fronius PV Inverter

Version:2023.3.1

Table of Contents

1. Introduction 2

2. Configuration — Fronius Symo GEN24 2

2.1. IP address..... 2

2.2. Ping test 3

2.3. Modbus 3

3. Configuration - Fronius Symo 4

3.1. IP address..... 4

3.2. Ping test 5

3.3. Modbus 6

3.4. Night mode 7

4. Contact 8

5. Directories 9

5.1. List of illustrations 9

1. Introduction

These instructions are used to configure the following Fronius PV inverters:

- <https://www.fronius.com/de/solarenergie/installateur-partner/technische-daten/alle-produkte/wechselrichter/fronius-symo-gen24/fronius-symo-gen24-8-0> [Fronius Symo GEN24 3.0 - 10.0 kW]
- <https://www.fronius.com/de/solarenergie/installateur-partner/technische-daten/alle-produkte/wechselrichter/fronius-symo/fronius-symo-3-0-3-m> [Fronius Symo 3.0 - 20.0 kW]



The *Light* version of the Fronius Symo is explicitly **not supported**, as it does not have a dedicated communication module. The integration of the Fronius Symo GEN24 (Plus) is limited to the pure function as a PV inverter.



The latest firmware should always be installed.

2. Configuration — Fronius Symo GEN24



Before configuring the PV inverter, make sure that it has been installed properly. Use the manufacturer's installation guide for this: [Installation guide — Fronius GEN24 & GEN24 Plus](#).

To integrate into the EMS, configure the device via the web interface. You can access this by calling up the IP address of the inverter in the browser. We recommend setting the assignment of the IP address to "Automatic" when commissioning the device.



To be able to access the web interface, your PC/notebook/smartphone must be in the same network as the inverter.

2.1. IP address

The connection between EMS and the PV inverter is always established via the customer network. For this purpose, the IP address of the PV inverter is stored statically in EMS. It is therefore necessary that the IP address of the PV inverter never changes.

- Variant 1: Configure the inverter according to the instructions so that it is assigned a static IP address.
 1. **Communication** → **Network**
 2. **Network** → **LAN**
 3. **LAN** → **IP address**: Set a free IP address in the address range of the router (default: 169.254.0.180)
 4. **LAN** → **Subnet mask**: Set the subnet mask used in the network (default: 255.255.255.0)
 5. **LAN** → **Gateway**: Set the IP address of the router as the gateway.
- Variant 2: Configure the inverter according to the instructions so that it is assigned a dynamic/automatic IP address and **additionally** configure the DHCP server in the customer network (cf. your router's documentation) so that the inverter is always assigned the same IP address.

1. **Communication** → **Network**
2. **Network** → **LAN**
3. **LAN** → Select the **Automatic** option

Then click on *Connect*. The inverter should now be connected via LAN, see figure [fig4:LAN-connected].

Netzwerk

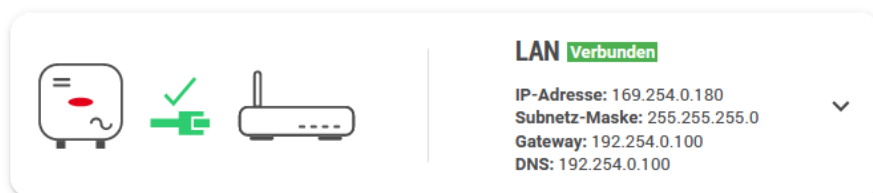


Figure 1. LAN connected

2.2. Ping test

To test the correct configuration of the IP address, we recommend pinging the inverter in the local customer network.

In the example below, the IP address **192.168.188.40** was set for the inverter in the configuration.

```
PING 192.168.188.40 (192.168.188.40) 56(84) bytes of data.  
64 bytes from 192.168.188.40: icmp_seq=1 ttl=64 time=3.23 ms  
64 bytes from 192.168.188.40: icmp_seq=2 ttl=64 time=1.89 ms  
64 bytes from 192.168.188.40: icmp_seq=3 ttl=64 time=3.08 ms  
64 bytes from 192.168.188.40: icmp_seq=4 ttl=64 time=0.889 ms  
  
--- 192.168.188.40 ping statistics ---  
4 packets transmitted, 4 received, 0% packet loss, time 6ms  
rtt min/avg/max/mdev = 0.889/2.273/3.229/0.952 ms
```

Figure 2. Ping test

If the inverter cannot be reached via ping, check the settings under [IP address](#).

2.3. Modbus



Technician login is required to adjust the Modbus settings. Take the access data from your invoice or contact Fronius Support with your PIN and device number. They will then send you an activation code with which you can reassign the password.

Make the following settings according to the instructions:

1. **Communication** → **Modbus**
2. **Modbus** → Activate **Slave as Modbus TCP** option

3. Configuration - Fronius Symo

3. **Modbus port** → Set the value **502** (default setting)
4. **SunSpec Model Type** → Set **float** (default setting)
5. **Counter address** → Set **200** (default setting)
6. **Inverter control via Modbus** → Deactivate (default setting)

The configuration has now been successfully completed. The settings should now look like Figure [Modbus settings](#):

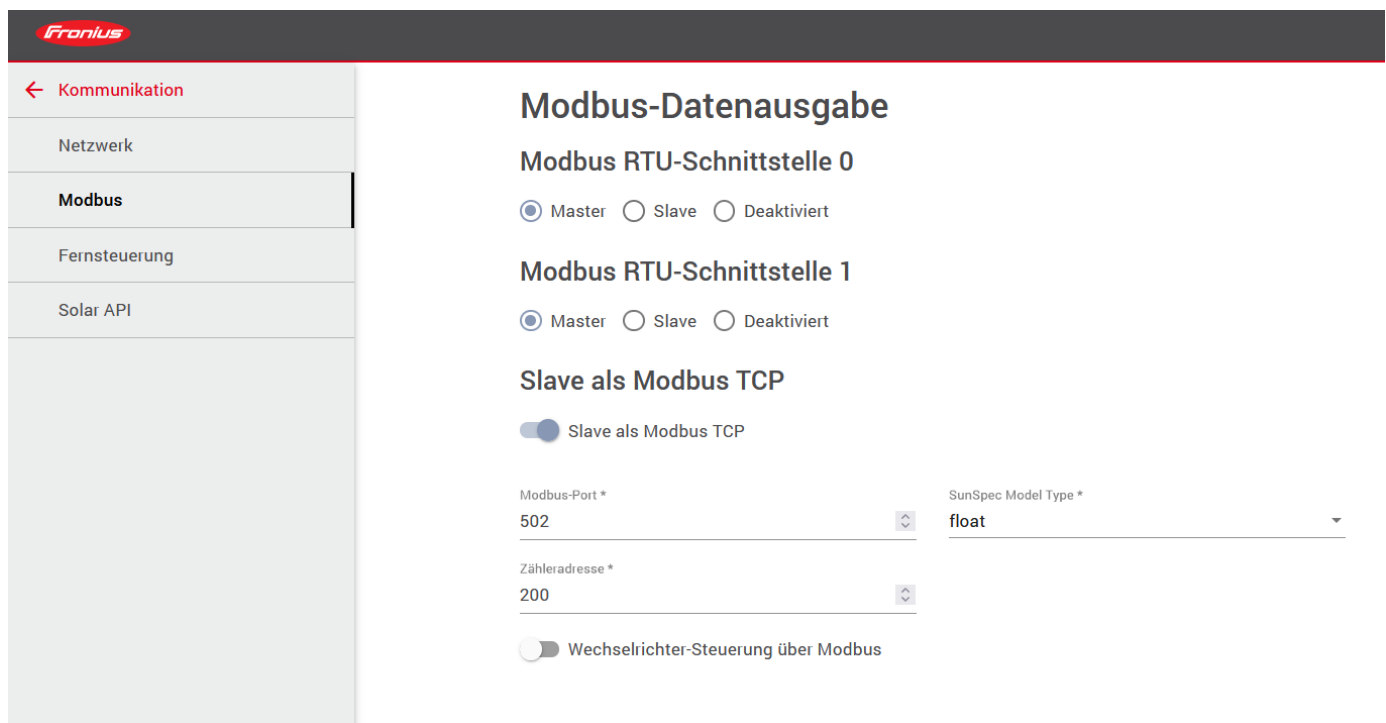


Figure 3. Modbus settings

Then continue with step [feedback service](#).

3. Configuration - Fronius Symo



Before configuring the PV inverter, make sure that it has been properly installed. Use the manufacturer's installation guide for this: [Installation Guide — Fronius Symo](#)

To integrate into the EMS, configure the device via the web interface. You can access this by calling up the IP address of the inverter in the browser. We recommend setting the assignment of the IP address to "Automatic" when commissioning the device.



To be able to access the web interface, your PC/notebook/smartphone must be in the same network as the inverter.

3.1. IP address

The connection between EMS and the PV inverter is always established via the customer network. For this purpose, the IP address of the PV inverter is stored statically in EMS. It is therefore necessary that the IP address of the PV

inverter never changes.

- Variant 1: Configure the inverter according to the instructions so that it is assigned a static IP address.
 1. **Settings** → **Network**
 2. **Network** → Select the setting **Internet via LAN** under **Connection mode**.
 3. Adjust the following settings under **LAN settings**
 4. **Obtain address** → **Static**
 5. **Hostname** → freely selectable (e. g. "PV")
 6. **IP address** → Set a free IP address in the address range of the router (default: 169.254.0.180)
 7. **Subnet mask** → Set the subnet mask used in the network (default: 255.255.255.0)
 8. **Gateway** → Set the IP address of the router as the gateway.
 9. **DNS server** → Set the IP address of the router as the DNS server.
- Variant 2: Configure the inverter according to the instructions so that it is assigned a dynamic/automatic IP address and **additionally** configure the DHCP server in the customer network (cf. your router's documentation) so that the inverter is always assigned the same IP address.
 1. **Settings** → **Network**
 2. **Network** → Select the setting **Internet via LAN** under **Connection mode**.
 3. Adjust the following settings under **LAN settings**
 4. **Obtain address** → **dynamic**

3.2. Ping test

To test the correct configuration of the IP address, we recommend pinging the inverter in the local customer network.

In the example below, the IP address 192.168.188.40 was set for the inverter in the configuration.

```
PING 192.168.188.40 (192.168.188.40) 56(84) bytes of data.  
64 bytes from 192.168.188.40: icmp_seq=1 ttl=64 time=3.23 ms  
64 bytes from 192.168.188.40: icmp_seq=2 ttl=64 time=1.89 ms  
64 bytes from 192.168.188.40: icmp_seq=3 ttl=64 time=3.08 ms  
64 bytes from 192.168.188.40: icmp_seq=4 ttl=64 time=0.889 ms  
  
--- 192.168.188.40 ping statistics ---  
4 packets transmitted, 4 received, 0% packet loss, time 6ms  
rtt min/avg/max/mdev = 0.889/2.273/3.229/0.952 ms
```

Figure 4. Ping test

If the inverter cannot be reached via ping, check the settings under [IP address](#).

3.3. Modbus



Admin login is required to adjust the Modbus settings. Take the access data from your invoice or contact Fronius Support with your PIN and device number. They will then send you an activation code with which you can reassign the password.

Make the following settings according to the instructions:

1. **Modbus** → Activate the option **tcp** under **Data output via Modbus**
2. **Modbus port** → Set the value **502** (*default setting*)
3. **String Control Address Offset** → Set the value **101** (*default setting*)
4. **Sunspec Model Type** → Set **float** (*default setting*)
5. The **Demo mode** and **Inverter control via Modbus** do **not** need to be activated

The settings should now look like Figure [Modbus settings](#):

Pv

Einstellungen

- ALLGEMEIN
- PASSWÖRTER
- NETZWERK
- FRONIUS SOLAR.WEB
- IO-ZUORDNUNG
- LASTMANAGEMENT
- PUSH SERVICE
- MODBUS**
- WECHSELRICHTER
- FRONIUS SENSOR CARDS
- ZÄHLER
- EVU-EDITOR

Modbus

☐ aus ☒ tcp ☐ rtu
 Modbus Port:
 String Control Adress-Offset:
 Sunspec Model Type: ☒ float ☐ int + SF
 Demo Modus: ☐
 Wechselrichter-Steuerung über Modbus: ☐

Steuerungs-Prioritäten

1. IO-Steuerung
 2. Dynamische Leistungsreduzierung
 3. Steuerung über Modbus

Legende:
 1 ... höchste Priorität
 2 ... mittlere Priorität
 3 ... niedrigste Priorität

Hinweis: eine Veränderung der Steuerungsprioritäten ist nur im EVU Editor Menü mit dem Service Passwort möglich.

Figure 5. Modbus settings

3.4. Night mode

By default, the Fronius Symo does not record any data during the night. This means that no measurement data is recorded in Online Monitoring either. We therefore recommend activating logging during the night (see [Settings - Night mode](#))

The settings can be found under: [**Settings**] → [**Fronius Solar.Web**]

Pv

Einstellungen

- ALLGEMEIN
- PASSWÖRTER
- NETZWERK
- FRONIUS SOLAR.WEB**
- IO-ZUORDNUNG
- LASTMANAGEMENT
- PUSH SERVICE
- MODBUS
- WECHSELRICHTER
- FRONIUS SENSOR CARDS
- ZÄHLER
- EVU-EDITOR

Fronius Solar.web

✓ ✕

Datenlogging Einstellungen

Abfragezyklus Wechselrichter 5 Minuten ▼

Abfragezyklus Fronius Sensor Cards 5 Minuten ▼

[aufgezeichnete Logdaten löschen ...](#)

Logging während der Nachtstunden

☐ Nein ☒ Ja

Hinweis: Durch das Aktivieren dieser Einstellung wird das Abschalten des Wechselrichters während der Nachtstunden verhindert. Die Einstellung "Nightmode" am Wechselrichter ist dadurch nicht mehr gültig.

Service Meldungen an Fronius Solar.web sofort senden

☐ Nein ☒ Ja

Hinweis: Durch das Aktivieren dieser Einstellung werden Service Meldungen sofort an Fronius Solar.web gesendet. Dies kann bei limitierten Datenvolumen zusätzliche Kosten verursachen.

Aktuelle Daten an Fronius Solar.web senden

☐ Nein ☒ Ja

Archivdaten an Fronius Solar.web senden

☐ niemals ☐ täglich ☒ stündlich

☐ 00:00 ☐ 01:00 ☐ 02:00 ☐ 03:00 ☐ 04:00 ☐ 05:00 ☒ 06:00 ☒ 07:00

☒ 08:00 ☒ 09:00 ☒ 10:00 ☒ 11:00 ☒ 12:00 ☒ 13:00 ☒ 14:00 ☒ 15:00

☒ 16:00 ☒ 17:00 ☒ 18:00 ☒ 19:00 ☒ 20:00 ☒ 21:00 ☐ 22:00 ☐ 23:00

[bei Solar.web registrieren ...](#)

Figure 6. Settings - Night mode

Activate logging during the night hours here.

The configuration has now been successfully completed.

4. Contact

4. Contact

For support, please contact:

Symphon-E Service

Telephone service: +49 (0) 371 45 85 68 - 100

E-mail service: symphon-e@heckert-solar.com

5. Directories

5.1. List of illustrations

Figure 1. LAN connected

Figure 2. Ping test

Figure 3. Modbus settings

Figure 4. Ping test

Figure 5. Modbus settings

Figure 6. Settings - Night mode